



ANTENNA MOUNTING DETAIL ON WOODEN POLE FOR RADIO SITES

NOTE: FOR SITES HAVING PHONE COMMUNICATION, CONTRACTOR TO PROVIDE PHONE LINE TO THE PUMP/TELEMETERING CONTROL PANEL IN LIEU OF ANTENNA MOUNTING POLE. TELEMETRY SUPPLIER SHALL DETERMINE IF RADIO TELEMETRY IS POSSIBLE.

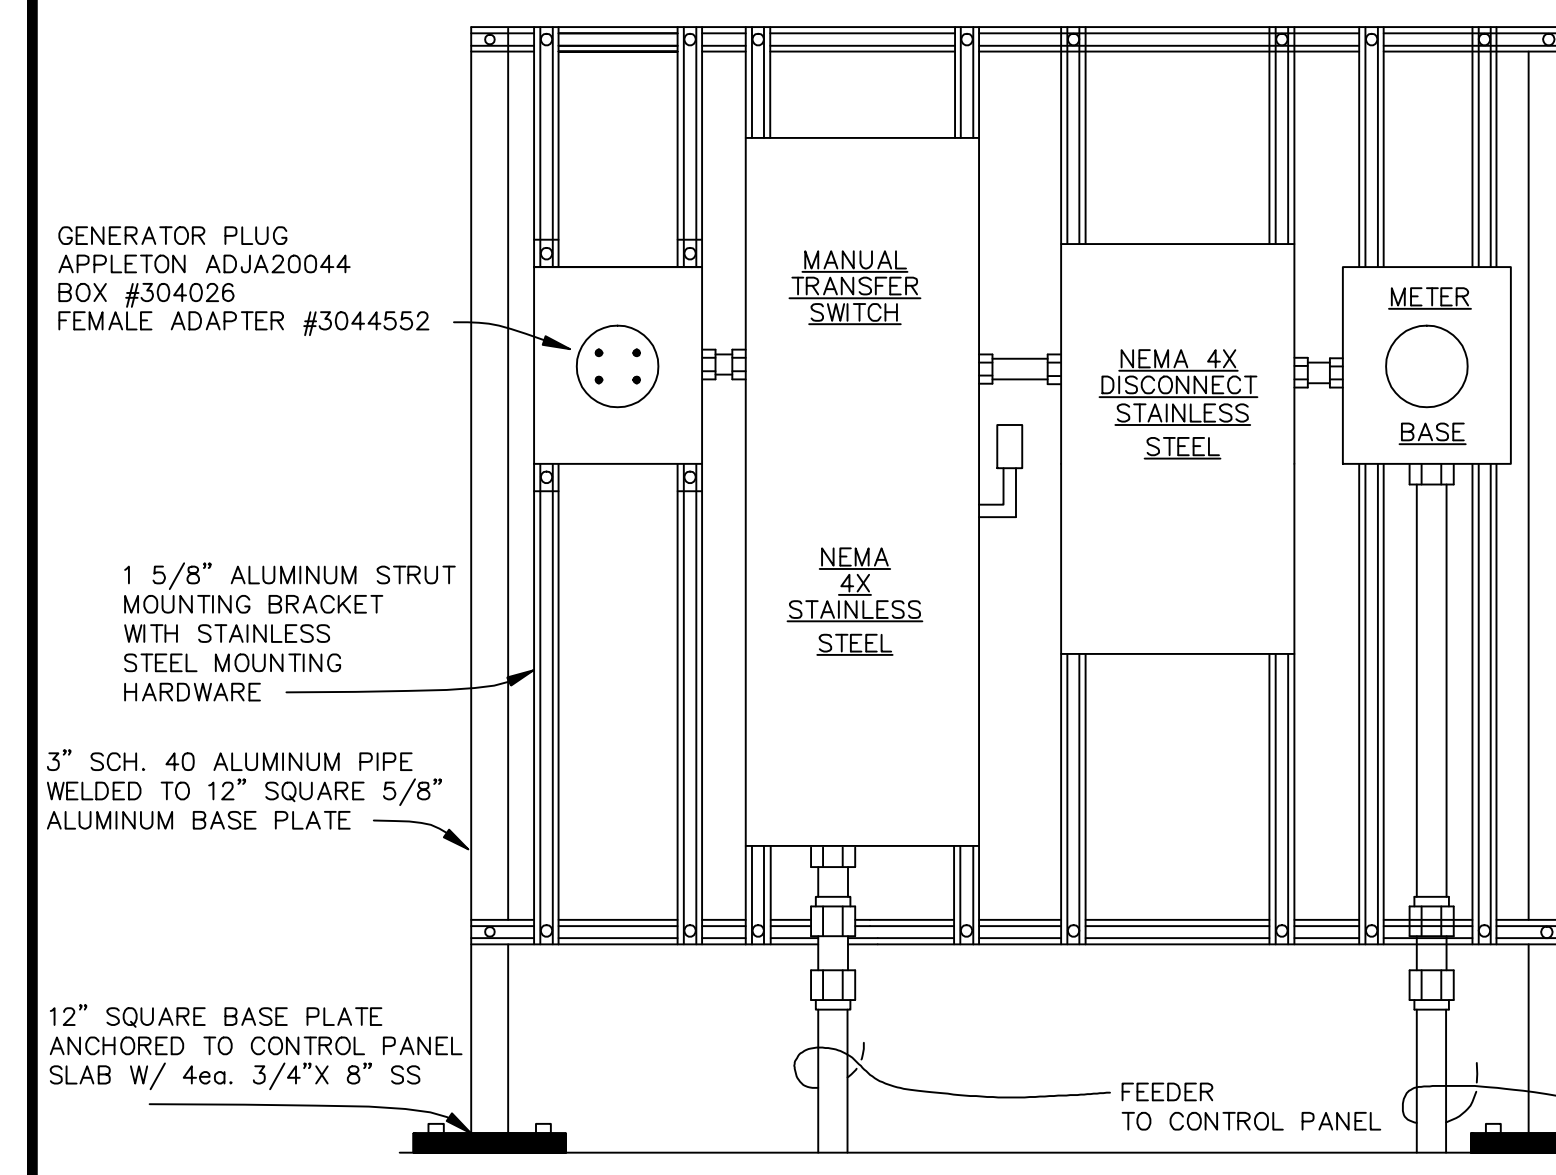


METER/DISCONNECT/TRANSFER SWITCH & GENERATOR PLUG

N.T.S. ALL ELECTRICAL SERVICES SHALL BE TO AEP SPECIFICATIONS

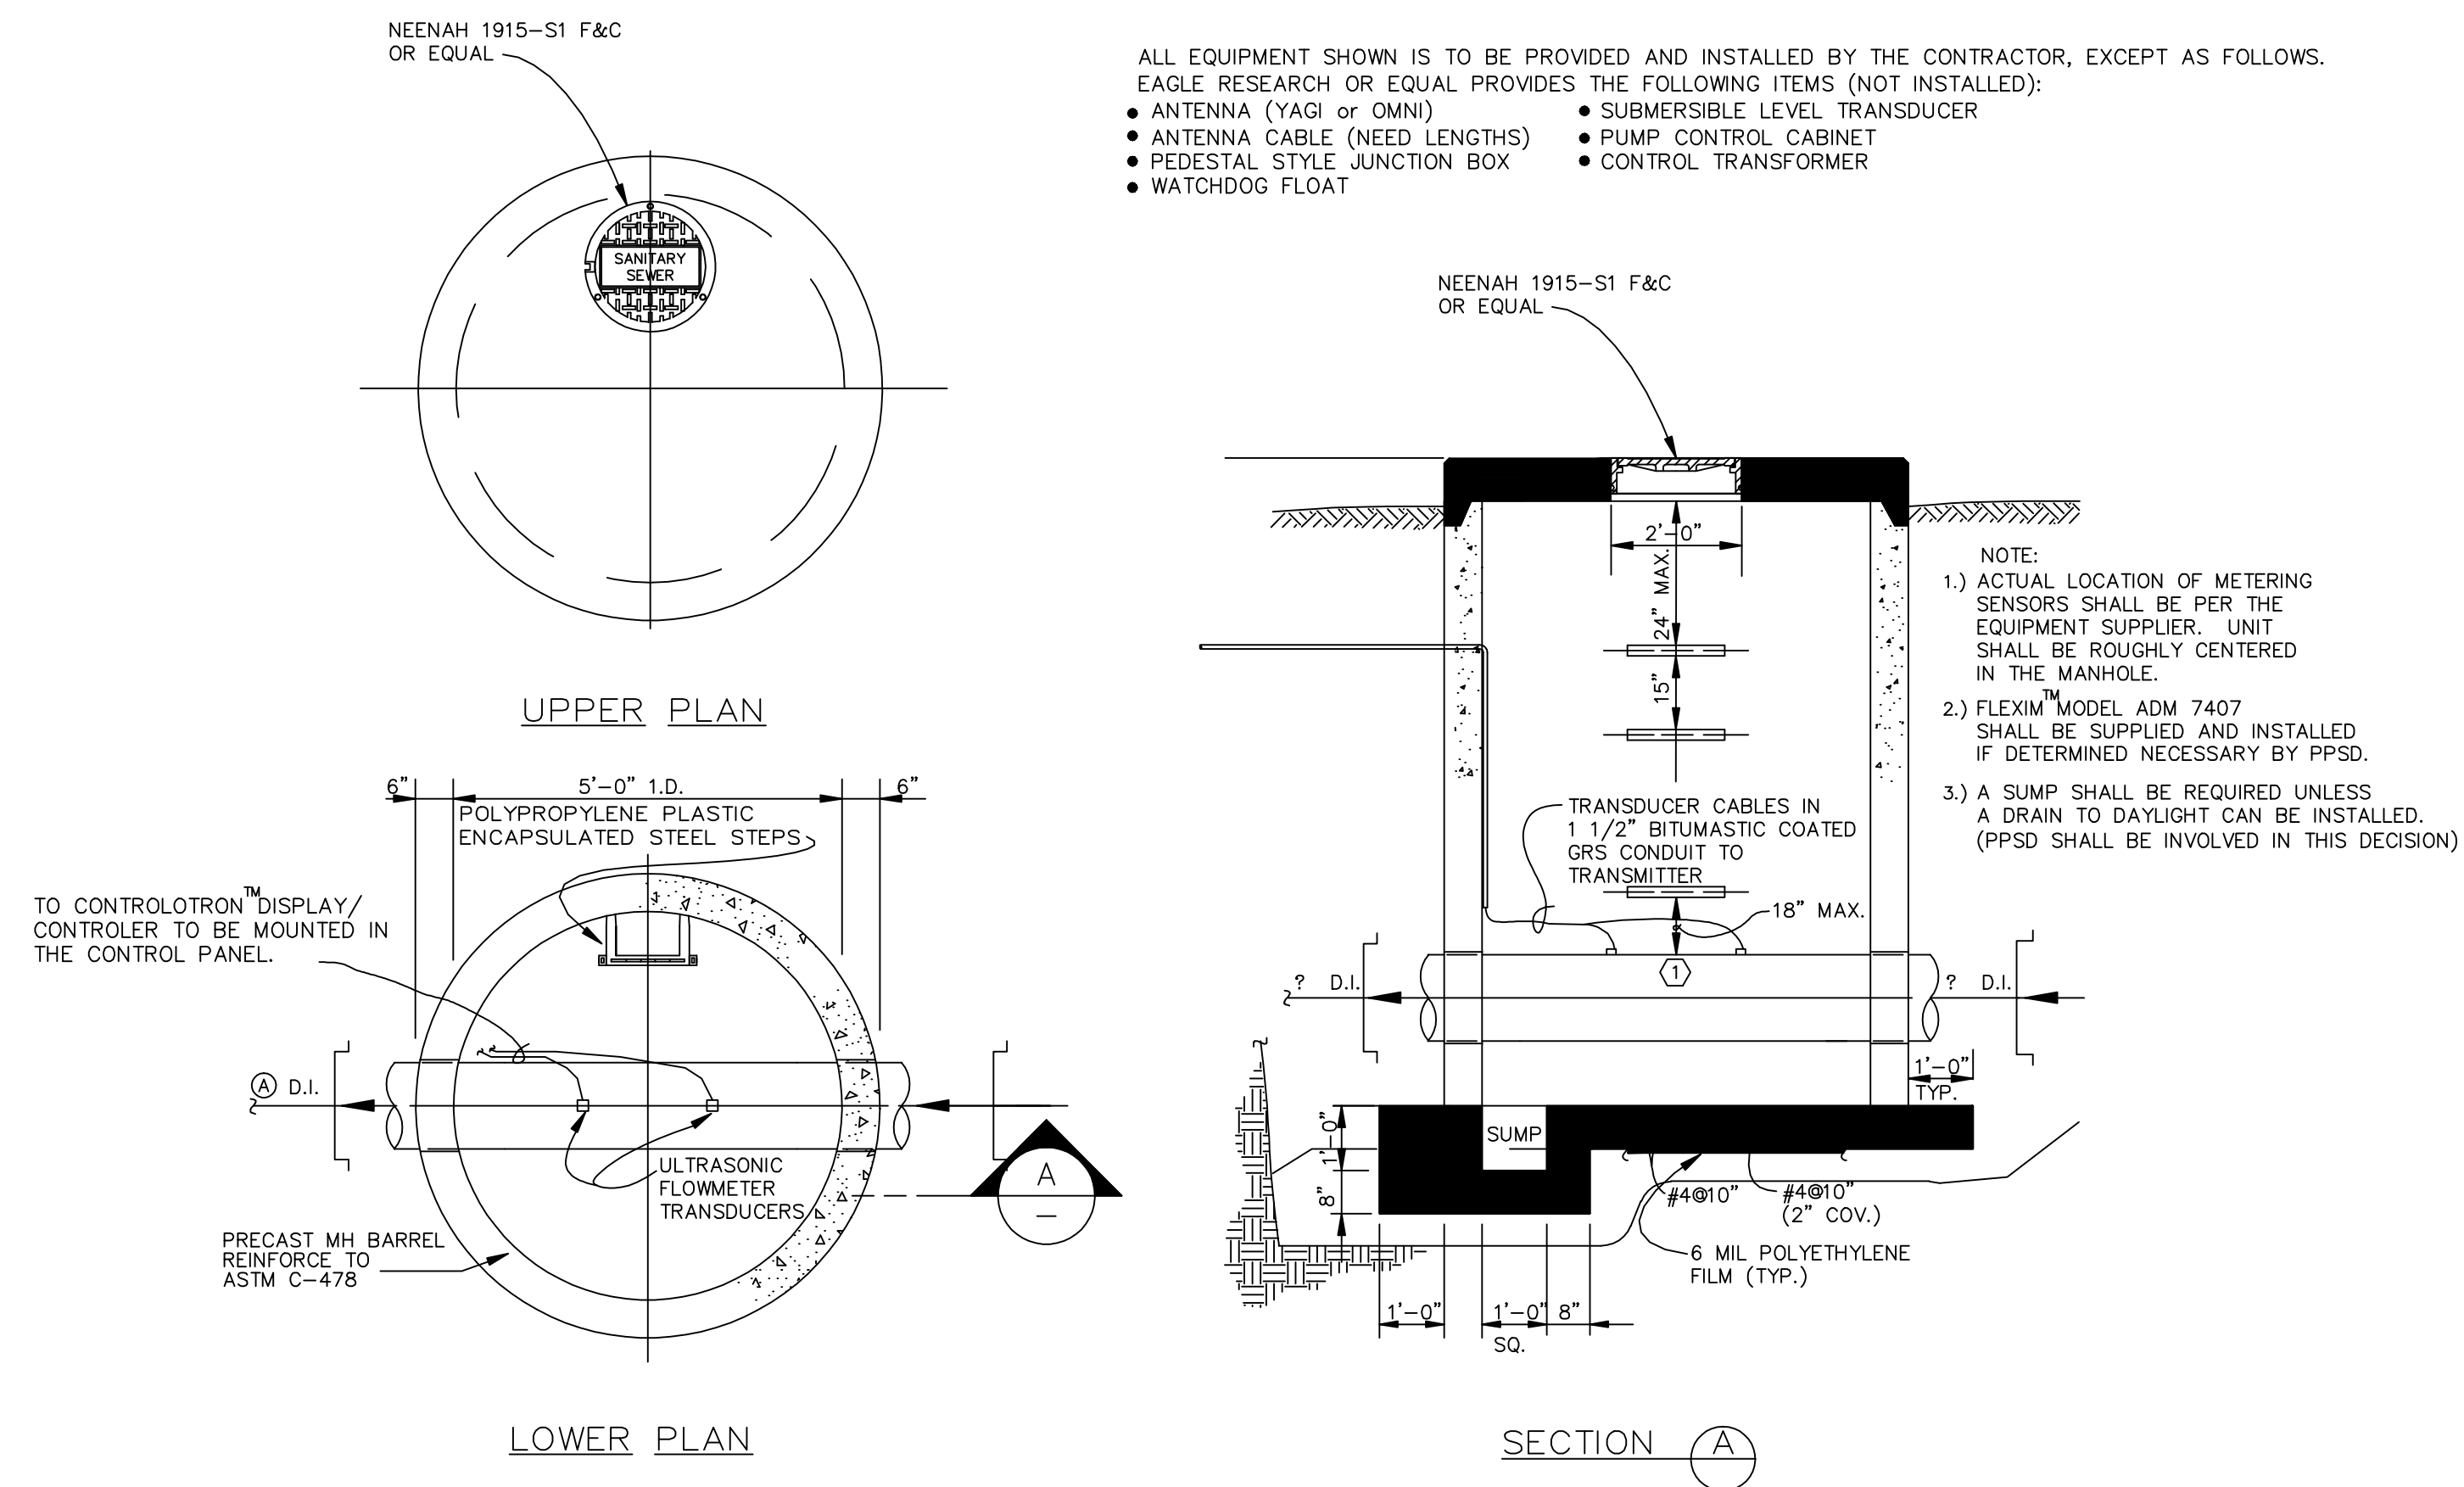

FLOW MONITORING (METER) VAULT


(IF REQUIRED BY PPSD) N.T.S.

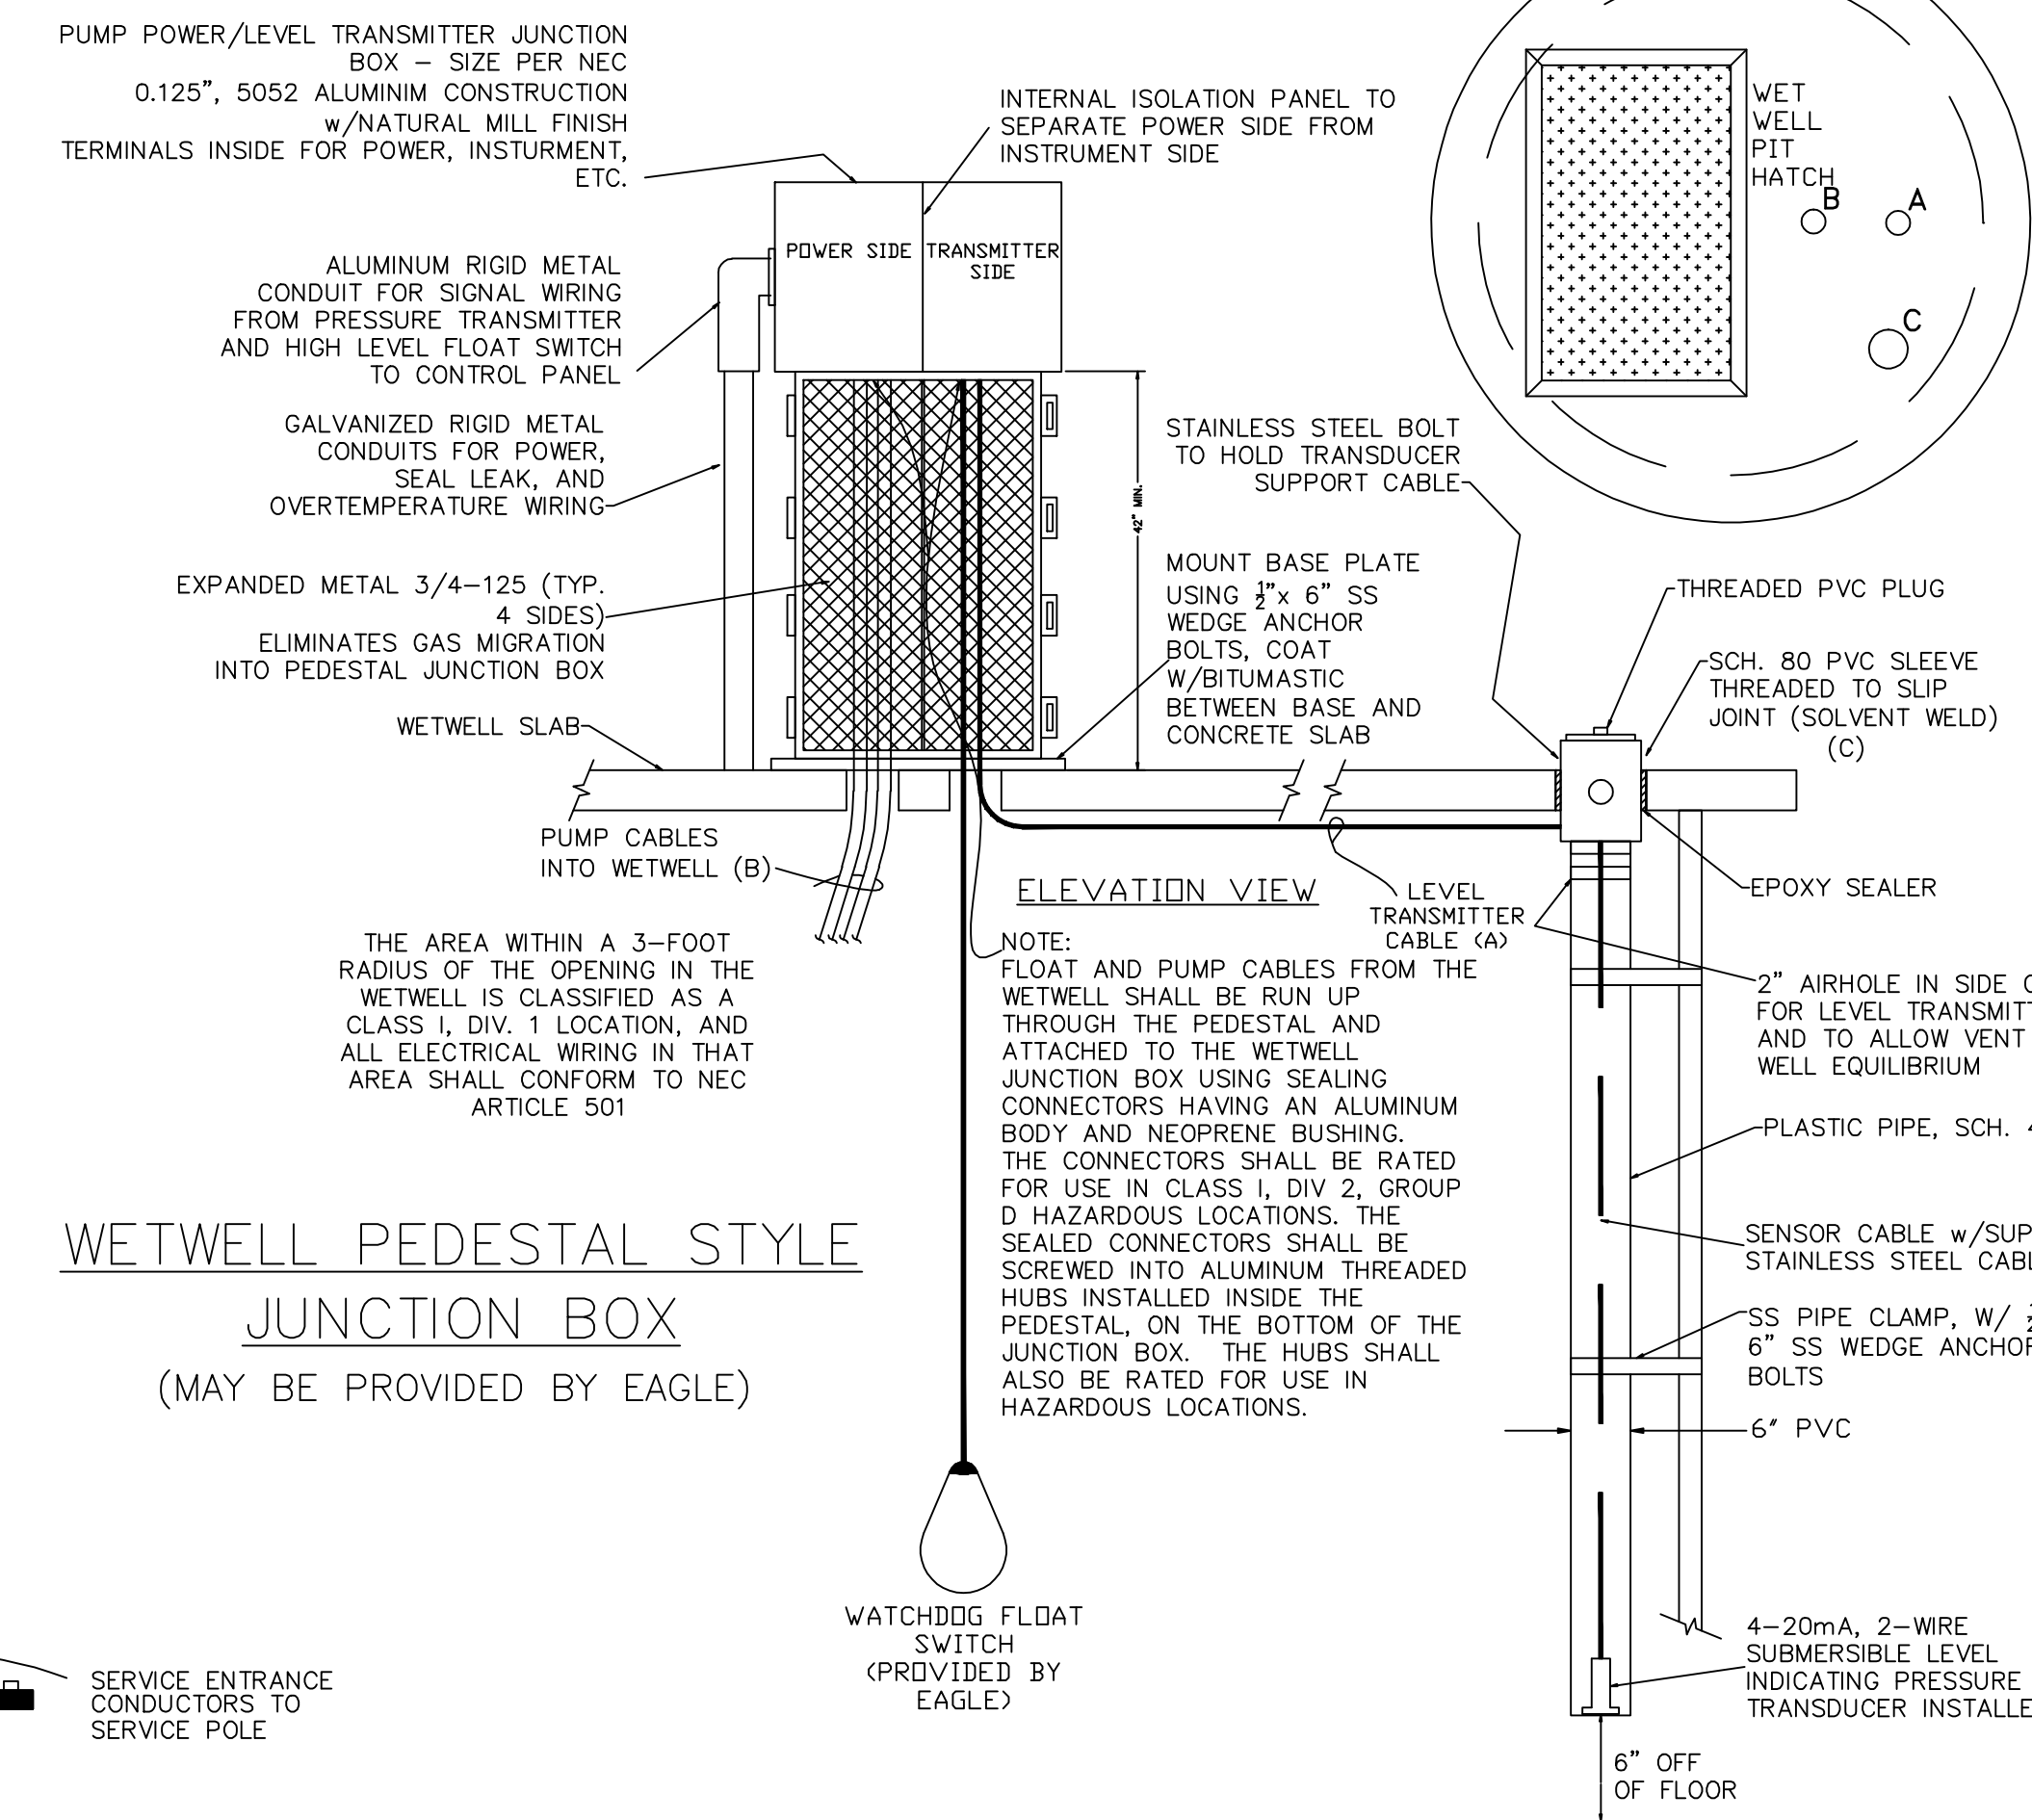


WETWELL PEDESTAL STYLE JUNCTION BOX

(MAY BE PROVIDED BY EAGLE)

STILLING WELL INSTALLATION SCHEME w/ SUBMERSIBLE PRESSURE/LEVEL TRANSMITTER

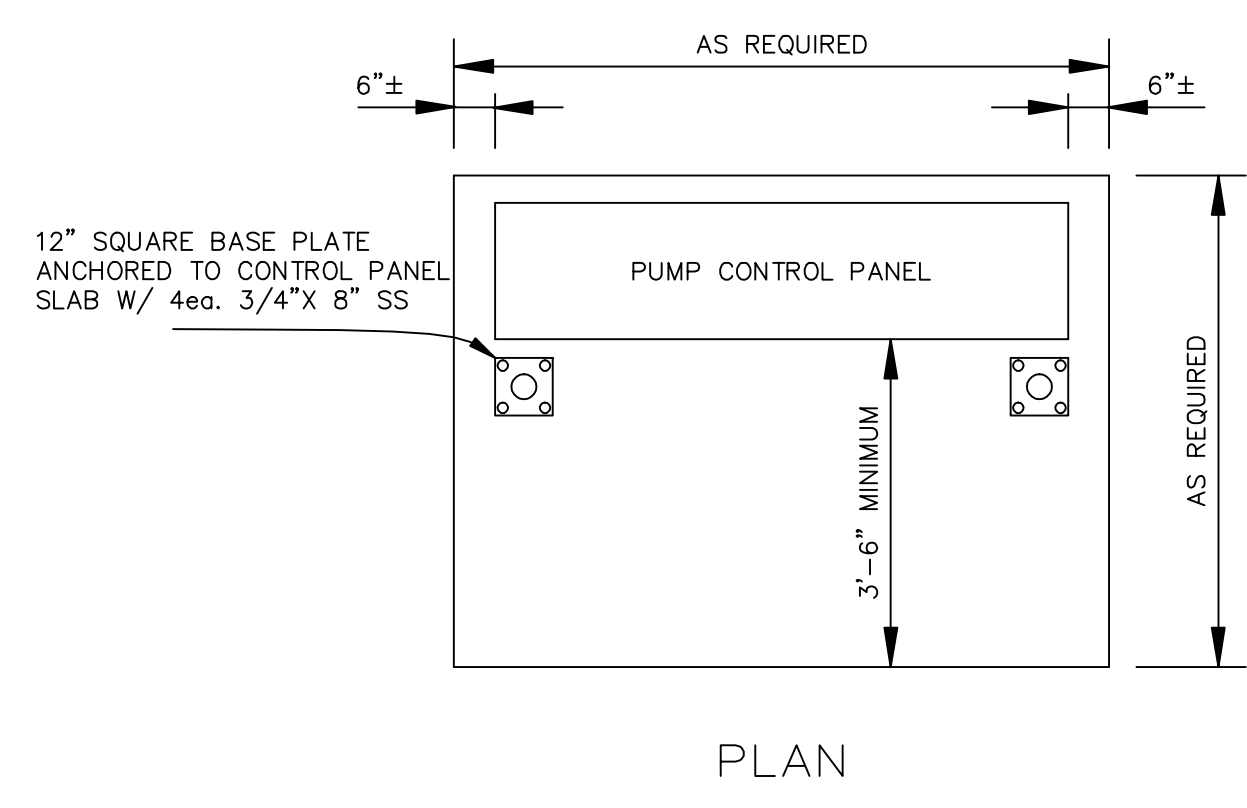


PLAN

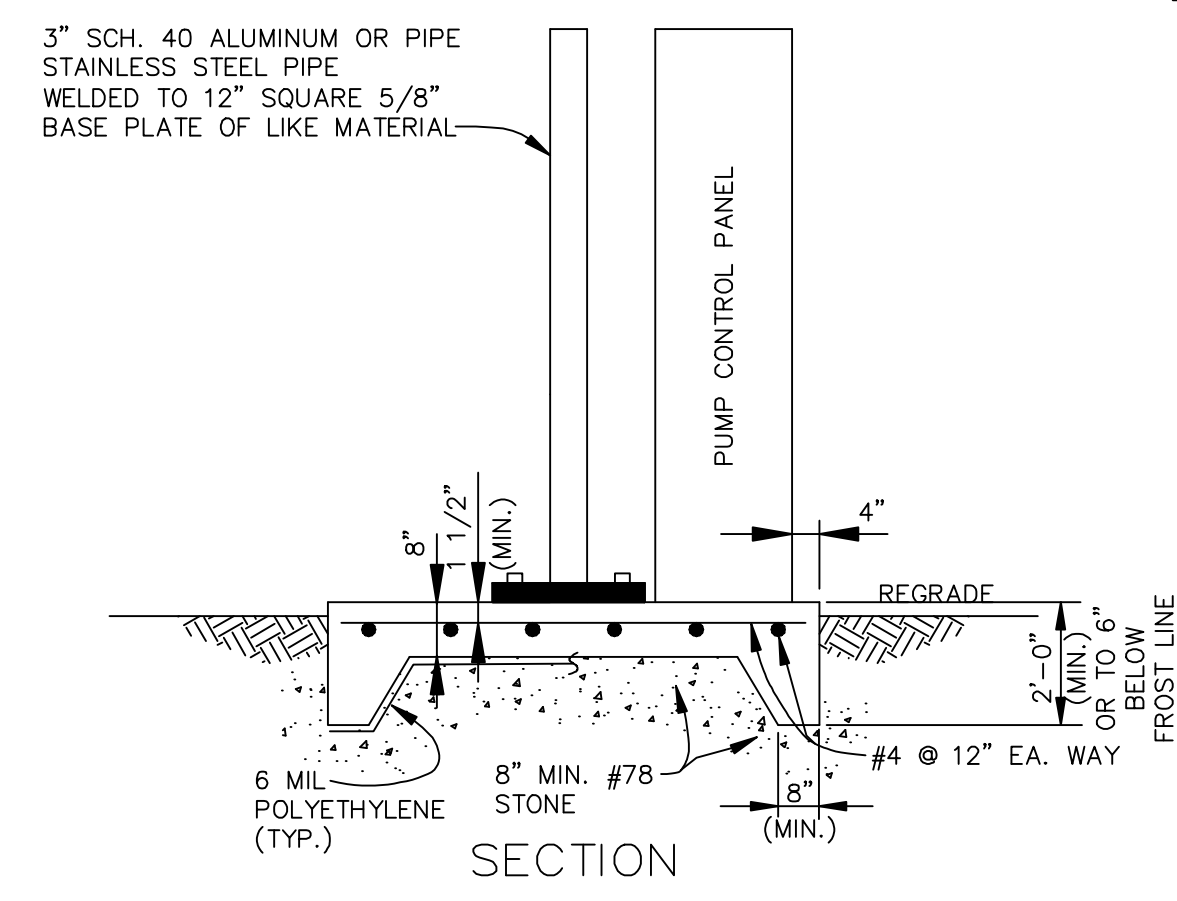


PUMP CONTROL PANEL SLAB

N.T.S.

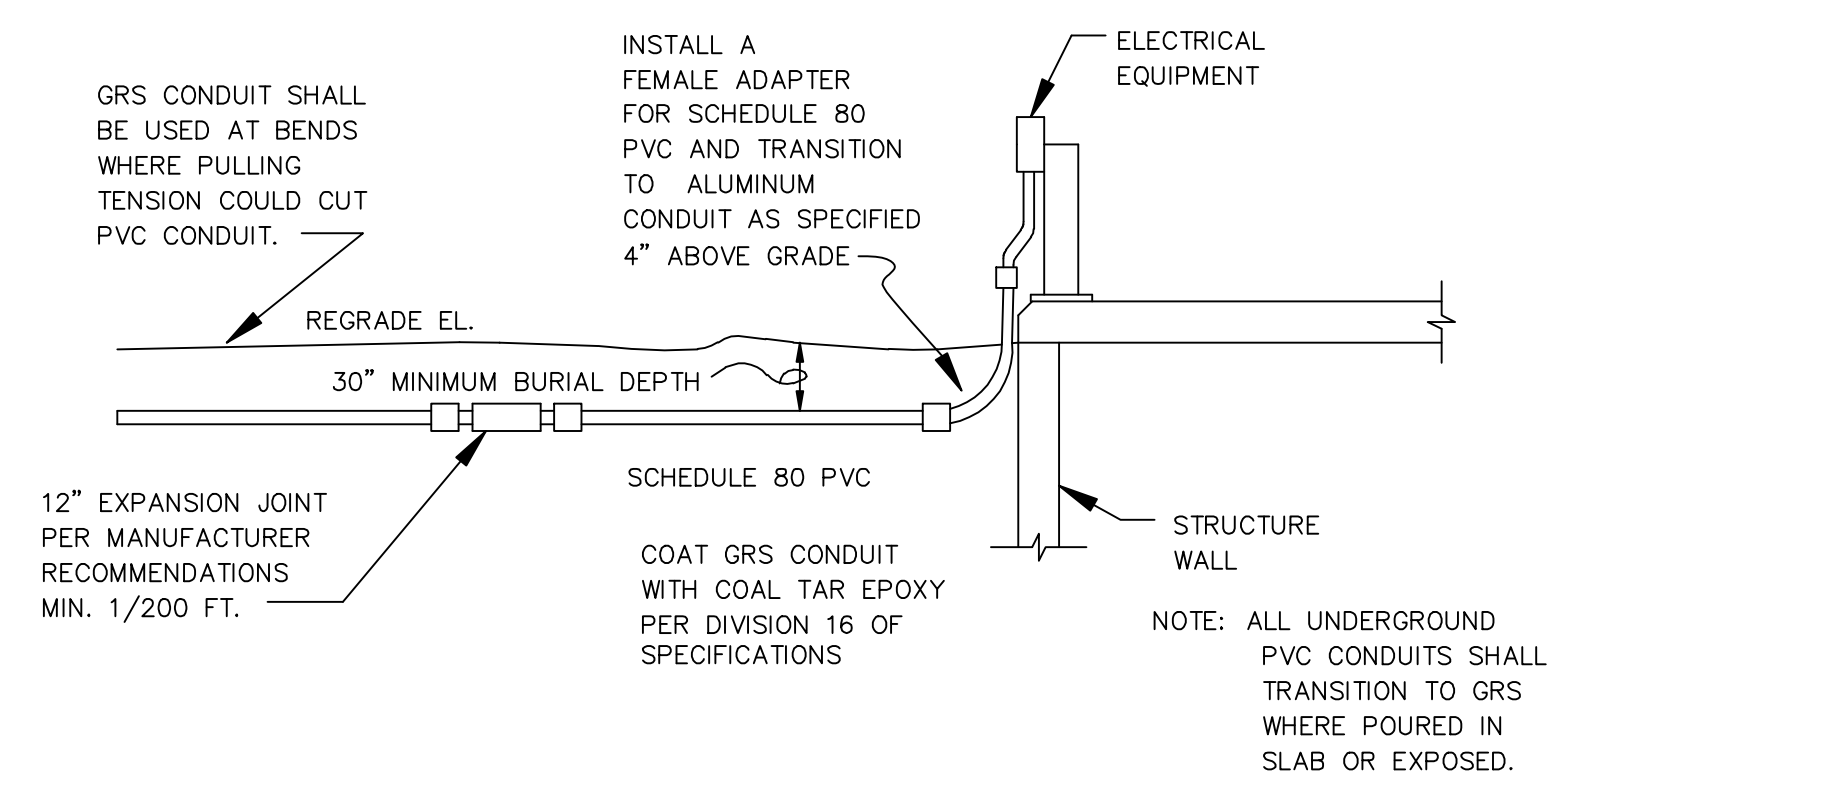

TYPICAL UNDERGROUND PVC CONDUIT TRANSITION

NOT TO SCALE

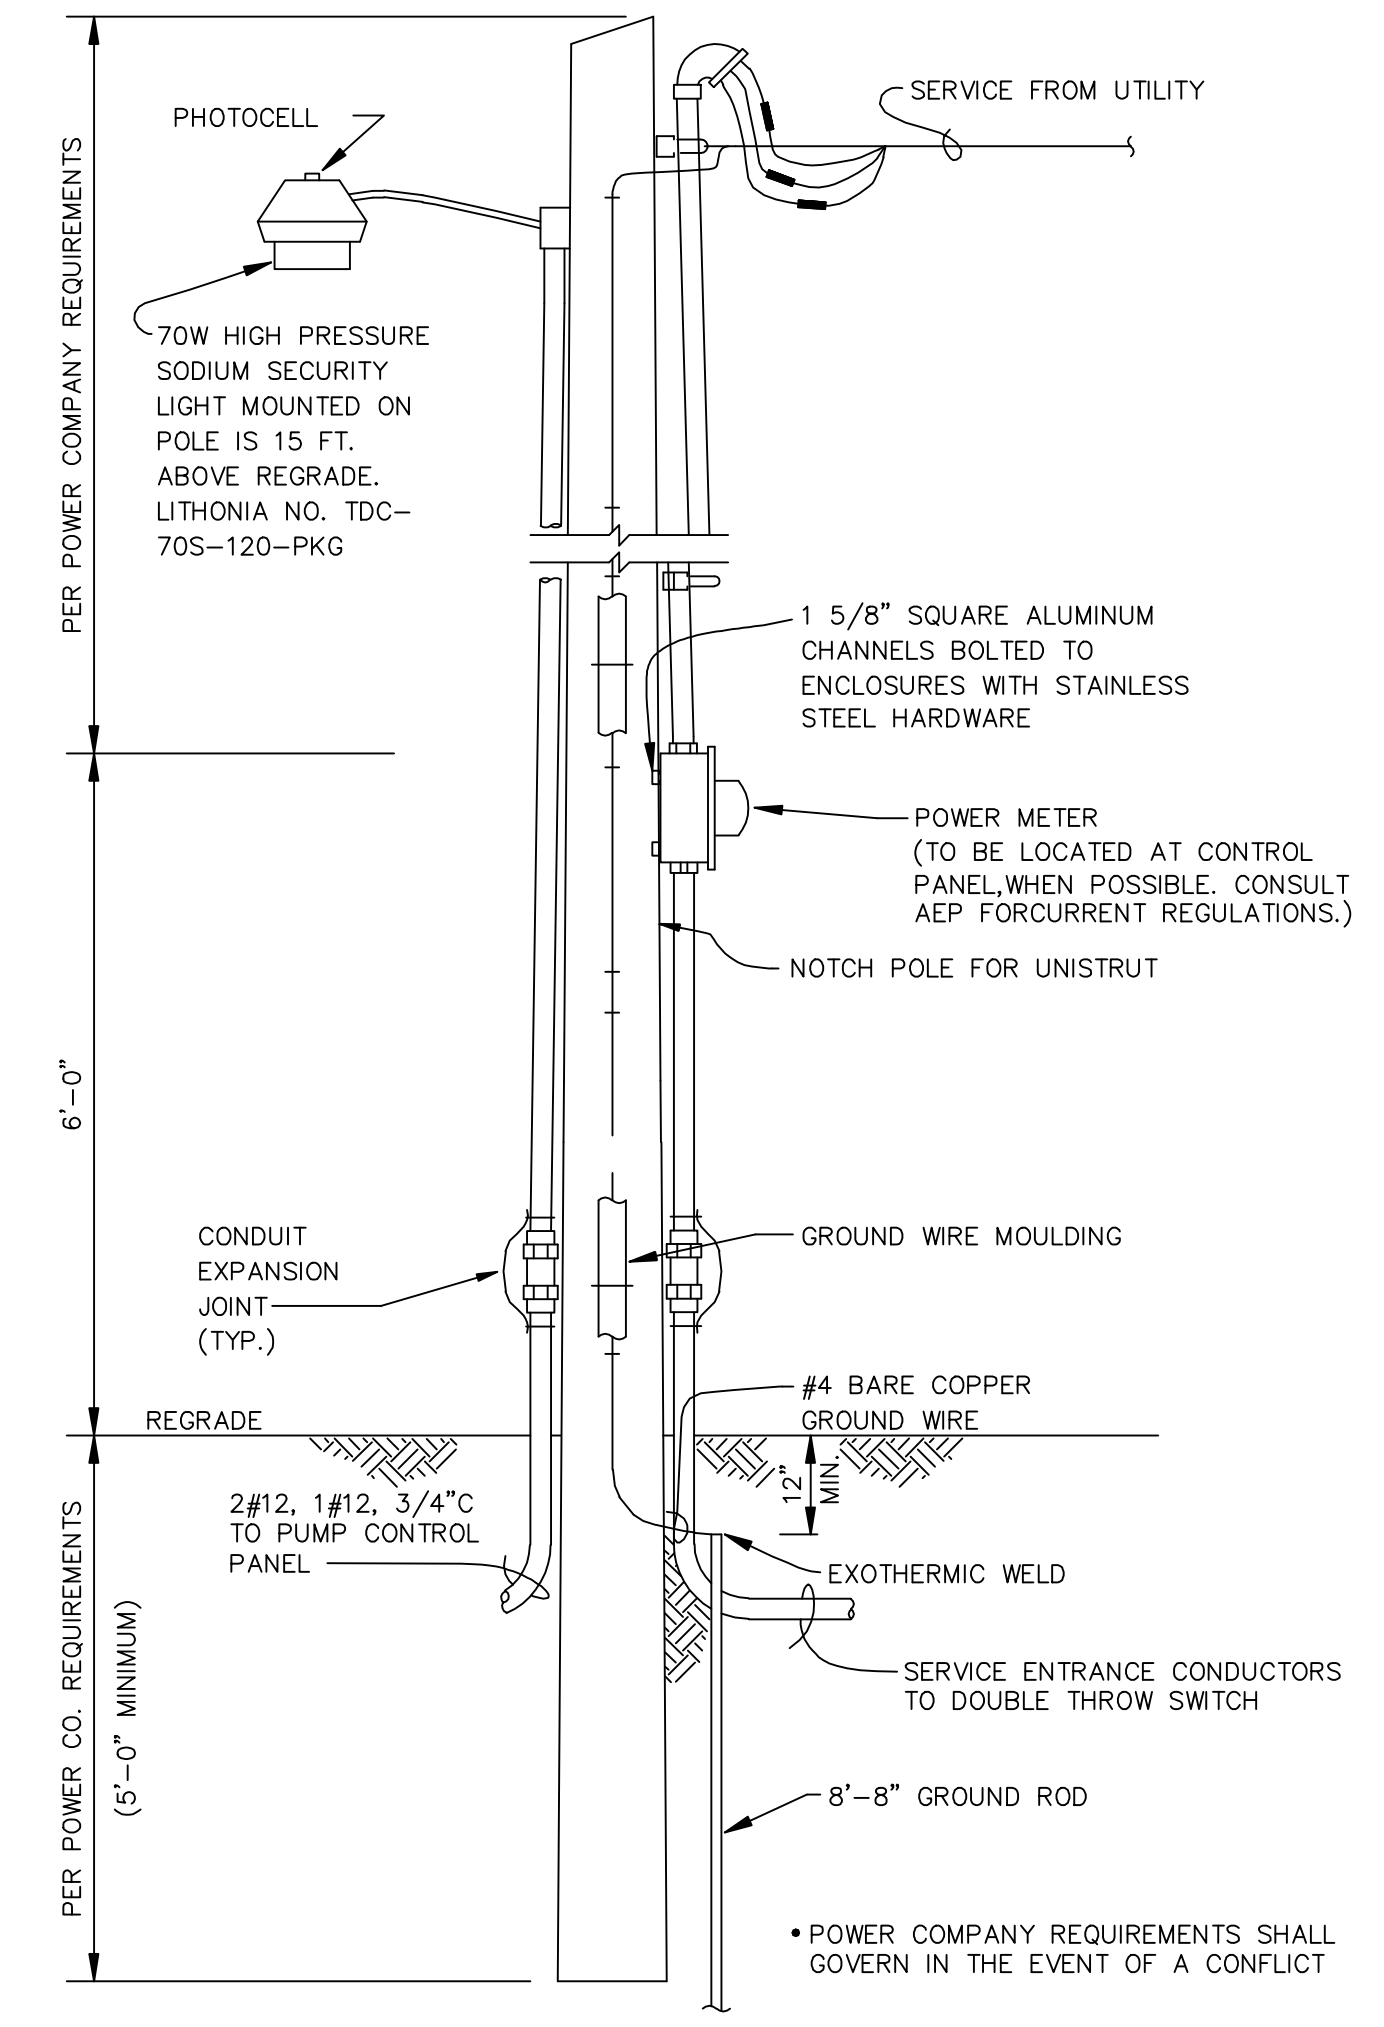

ELECTRIC SERVICE POLE DETAIL

N.T.S.

NO.	DATE	DESCRIPTION
REVISIONS		
Putnam Public Service District WASTEWATER COLLECTION SYSTEM Scott Depot, West Virginia		
PUMP STATION DETAIL DRAWINGS APPROVED THROUGH DISTRICT SEWER ORDINANCE I		
DRAWN BY: DLM		CHECKED BY: JEH
SCALE: AS SHOWN		DATE: FEB, 2007
		DRAWING
		PS 3 of 3